



THREE PHASE DRY TYPE AUTOTRANSFORMER
AUTOTRANSFORMATEUR SEC TRIPHASÉ

HV/HT	600Y/346V (60HZ)	385A
	480Y/277V (50/60HZ)	385A

BIL -

TERM. BORNES HO H1 H2 H3

VOLTS	CURRENT COURANT	% RATED VOLTAGE % TENSION NOMINALE	CONNECTION EACH PHASE CONNEXION PAR PHASE

LV/BT	480Y/277V (60HZ)	48 1A
	380Y/219V (50/60HZ)	48 1A

BIL -

TERM. BORNES XO X1 X2 X3

Cust. Ref. / Réf. du client

Serial No. / No. de série

Part No. / No. de pièce **245855**

kVA **400**

TYPE **K**

Cooling / Refroidissement **ANN**

Temp. Rise / Echauffement **150 °C**

Temp. Class / Classe de Temp. **220 °C**


Frequency / Fréquence **50/60 Hz**

Impédance % @ 170 °C **1.2**

Encl. Type / Type de boîtier **3R**

Wt lbs/kg / Poids **628/285**

Winding / Enroulement **CU**



dmm3302b 1

SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 8.25 INCHES

RATED KVA AT 50/60HZ:320KVA

VOLTAGES SHOWN ARE FOR 3 PHASE, 4 WIRE SYSTEMS. NEUTRAL AND GROUND CONNECTIONS SHOULD BE MADE IN ACCORDANCE WITH LOCAL ELECTRICAL CODE AND STANDARDS REQUIREMENTS





TITLE: 3PH AUTO TRANSFORMER
NAMEPLATE INFORMATION

DES: DCORTEZ
DATE: 24/03/27
SCALE: NTS
NO. DATE BY REVISION

SHEET 1 OF 2


EDB 245855

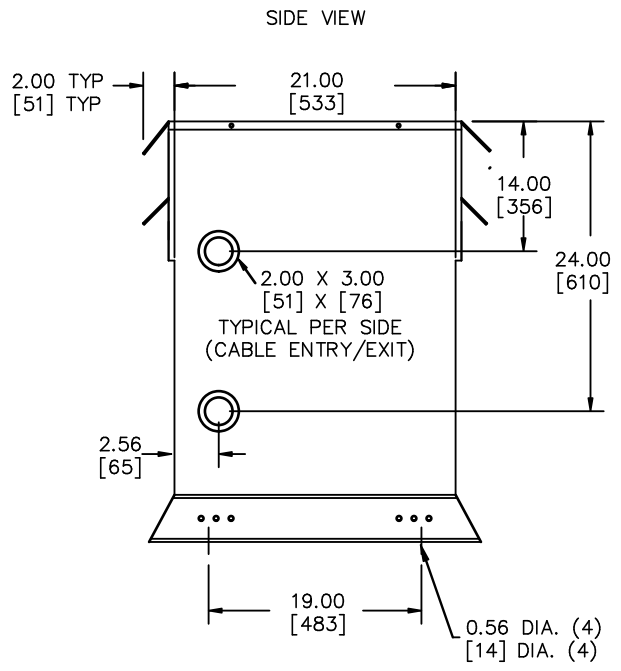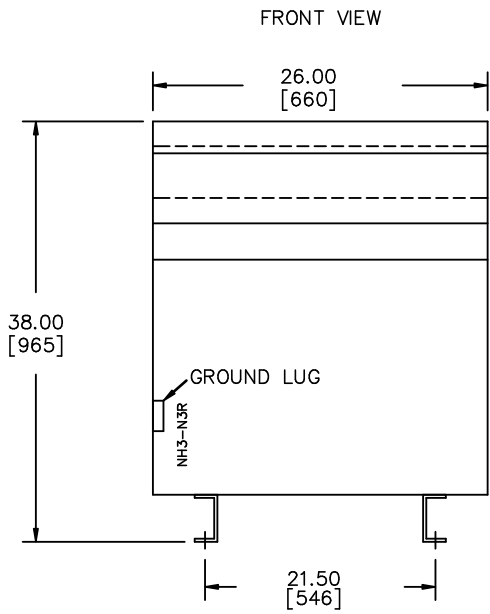


All Dimensions in inches[mm]

ENCLOSURE COLOR :ANSI 61 GREY- OUTDOOR

HV TERMINAL DETAIL

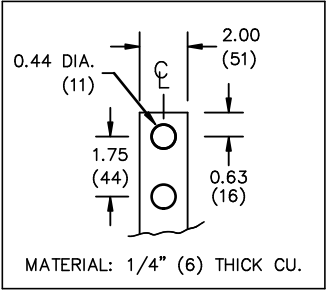

LV TERMINAL DETAIL

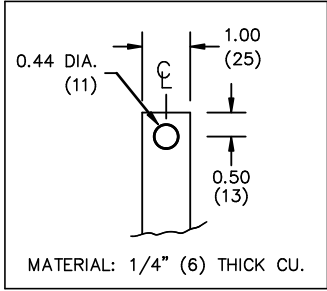

CUSTOMER NOTES:

- HV TERMINATED AT TOP FRONT
- LV TERMINATED AT BOTTOM FRONT



TITLE: 3PH AUTO TRANSFORMER				
				DES: DCORTEZ
				DATE: 24/03/27
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 2 OF 2

EDB 245855